



Parametric study on the regeneration heat requirement of an amine-based solid adsorbent process for post-combustion carbon capture



Wenbin Zhang, Hao Liu^{*}, Yuan Sun, Janis Cakstins, Chenggong Sun^{*}, Colin E. Snape

Faculty of Engineering, University of Nottingham, University Park, Nottingham NG7 2RD, UK

HIGHLIGHTS

- Revised equation of regeneration heat is proposed to include process related factors.
- Key parameters (e.g. heat of adsorption) experimentally determined.
- Parametric analysis made on both physical properties and process related parameters.
- Calculated regeneration heat for PEI/silica sorbent based system is 2.46 GJ/tCO₂.
- Working capacity, moisture adsorption and heat recovery are most influential factors.

ARTICLE INFO

Article history:

Received 22 October 2015
Received in revised form 18 January 2016
Accepted 19 January 2016
Available online 10 February 2016

Keywords:

Amine-based solid adsorbent
PEI-silica adsorbent
Regeneration heat
Parametric study
Post-combustion capture

ABSTRACT

The thermal energy required for regeneration of CO₂-rich adsorbents or absorbents is usually regarded as the most important criterion to evaluate different materials and processes for application in commercial-scale CO₂ capture systems. It is expected that the regeneration heat can be greatly reduced by replacing the mature aqueous monoethanolamine (MEA) technology with amine-based solid adsorbents capturing systems, due to the much lower heat capacity of solid adsorbents comparing to aqueous MEA and the avoidance of evaporating a large amount of water in the regenerator. Comparing to the MEA technology, the regeneration heat for solid adsorbent based systems has not received adequate attention especially on the impacts of process related parameters. Further, the methodologies used in previous investigations to calculate the regeneration heat may have deficiencies in defining the working capacities, adopting proper heat recovery strategies and/or evaluating the effect of moisture co-adsorption. In this study, an energy equation to calculate the regeneration heat has been revised and proposed to systematically evaluate the most important parameters affecting the regeneration heat, including the physical properties of the adsorbents and process related variables including the heat of adsorption, specific heat capacity, working capacity, moisture adsorption of the polyethyleneimine (PEI)/silica adsorbent, the swing temperature difference and the degree of heat recovery. Based on the parametric analysis, the calculated regeneration heat for the PEI/silica adsorbent based system is found to be around 2.46 GJ/tCO₂, which is much lower than the value of 3.9 GJ/tCO₂ for a typical aqueous MEA system and is also lower than 3.3 GJ/tCO₂ for an advanced MEA system. Sensitivity analysis of all the parameters has also been conducted and the results have shown that working capacity, moisture adsorption and heat recovery ratios are the most influential factors. With more proficiency and development in the energy efficient process designs, the advantages of a solid adsorbent based capturing system over typical MEA systems will be justified.

© 2016 The Authors. Published by Elsevier Ltd. This is an open access article under the CC BY license (<http://creativecommons.org/licenses/by/4.0/>).

1. Introduction

Carbon Capture and Storage (CCS) from large point sources such as coal-fired power plants has been considered as one main technology to address rising CO₂ emissions as a result of continual fossil fuel utilization. Post-combustion capture (PCC) is a front runner for future commercial deployment of CCS in fossil fuel power

^{*} Corresponding authors. Tel.: +44 115 8467674 (H. Liu), +44 115 7484577 (C. Sun).

E-mail addresses: liu.hao@nottingham.ac.uk (H. Liu), cheng-gong.sun@nottingham.ac.uk (C. Sun).

plants, partly due to the fact that it can be retrofitted to the existing power plants. However, implementing CCS in fossil fuel power plants will result in an increase in the cost of electricity by up to 80% according to the current state-of-art technology [1–3] as the energy requirement for the whole CCS chain is high. For capture, the energy consumption is the sum of the thermal energy needed to regenerate the solvents/sorbents and the electrical energy required to operate pumps, blowers and fans. Further, energy is also required to compress the CO₂ to the final pressure required for transport and storage. Among these energy requirements for capture, the regeneration heat greatly impacts on the operational costs and the overall energy efficiency of the CCS-integrated power plant. In principle, the regeneration heat for a post-combustion CO₂ capture process with an aqueous solvent or a solid adsorbent includes the sensible heat required to elevate the solvent or sorbent to the desorption temperature, the latent heat required to overcome the endothermic reaction responsible for removing CO₂ from the solvent or sorbent and the latent heat for water vaporization.

Monoethanolamine (MEA) scrubbing technology has been successfully demonstrated in gas- and coal-fired plants with power outputs as large as 30–40 MW [4] and is treated as a benchmark technology for CO₂ capture from large-scale power plants [3,5–7]. A regeneration heat of 4.2 GJ/tCO₂ was proposed by Chapel et al. [8] for their optimized MEA-based CCS process – Econamine FG™ technology. Alie et al. [9] concluded that the lowest energy requirement of 4 GJ/tCO₂ could be achieved at lean solvent loading between 0.25 and 0.30 mol CO₂/mol MEA using a flow sheet decomposition method. Singh et al. [10] modelled the MEA process for a 400 MWe coal fired power plant and estimated the specific thermal energy requirement to be 3.8 GJ/tCO₂. In average, a value of 3.9 GJ/tCO₂ can be regarded as the energy requirement for a benchmark MEA based capture system.

The high energy requirement makes CCS process costly. Technology developers and researchers have concentrated their effort on developing new and/or optimizing existing technologies to minimize the regeneration heat. For example, Li et al. [11] investigated the electrical efficiency of the supplementary fired combined cycles integrated with the MEA-based capture system and concluded that the modifications can reduce the efficiency penalty caused by CO₂ capture to only 2.6% of Lower Heating Value (LHV). The Fluor Econamine FG Plus™ technology requires a much lower energy requirement of 3.24 GJ/tCO₂ [12] which is achieved by optimizing process configurations such as split flow, absorber intercooling and improved solvent formulation. Similarly, Abu-Zahra et al. [6] also proposed a 30% MEA absorption system with the thermal energy requirement of 3.3 GJ/tCO₂ achievable through optimizing the lean solvent loading, the amine solvent concentration as well as the stripper operating pressure. Therefore, a representative value of 3.3 GJ/tCO₂ has been adopted in this paper as the energy requirement for an advanced MEA based system with optimized process configurations. Although it has been reported that some other amine aqueous solutions based systems may lead to an even lower energy requirement, such as 2.5–2.6 GJ/tCO₂ [13], the 30% MEA absorption system is the most well-known and mature technology and therefore is used as a reference for comparison with our proposed polyethyleneimine (PEI)/silica adsorbent based system.

In recent years, a great deal of effort has been made on the development of solid sorbents for PCC due to their potential advantages in lower regeneration heat requirement, the avoidance of amine evaporation and reduced corrosion. Among these solid sorbents, various amine-based solid adsorbents have been shown to be promising CO₂ capture materials due to their high adsorption capacities and reliable regeneration for coal and natural gas fired power plants and even for air capture [14–21]. Apart from a few

pilot trial tests recently conducted [22,23], most experimental investigations on amine-based solid adsorbents have been limited to relatively small scales such as thermal gravimetric analyzer (TGA) and recently in fluidized bed reactors [21,24,25]. The status of the research on PCC with solid adsorbents is still at the early stages of R&D and therefore there is significant deficiency in the data availability especially in the context of a specific process. Theoretical estimation of energy penalties for the PCC process is essential before scaling up to a sub-commercial demonstration or a full-scale commercial trial.

By replacing the amine carrier from aqueous water to solid substrates, it is believed that the regeneration heat can be greatly reduced due to the much lower heat capacity of solid sorbents comparing to aqueous MEA and the avoidance of evaporating significant amounts of water in the regenerator. However, unlike MEA technology, which has been extensively investigated for process optimization to minimize the regeneration heat, a comprehensive knowledge on the regeneration heat of solid adsorbent system is lacking, especially concerning the impact of key parameters. Gray et al. [17] proposed a simplified energy equation to calculate the regeneration heat for a solid adsorbent based system:

$$Q_r = \Delta H_a + mC_{p,s}\Delta T \quad (1)$$

where Q_r (kJ/mol) is the regeneration heat, ΔH_a (kJ/mol) is the heat of adsorption, m (kg) is the solid mass, $C_{p,s}$ (kJ/kg K) is the solid specific heat capacity and ΔT (K) is the change in temperature. Using a similar equation, Sjoström and Krutka [26] estimated the regeneration heat for different types of amine based adsorbents and found the values varying in a large range of 1.9–6.1 GJ/tCO₂ depending on the amine types, regeneration conditions and working capacities. Based on Eq. (1), Heesink et al. [27] estimated a regeneration heat of 1.7 GJ/tCO₂ for their amine based solid adsorbents assuming a very high working capacity of 3.1 mmol/g. By adding a term of vaporization heat of water into Eq. (1), Quang et al. [28] estimated the regeneration heat to be in the range of 2.1–4.2 GJ/tCO₂ for their PEI impregnated adsorbent, also with an assumption of high working capacity of 3–3.4 mmol/g. Applying Eq. (1), Li et al. [29] calculated the regeneration heat for PEI/silica adsorbents with different molecular weights of PEI and found the values to be around 1.7–1.8 GJ/tCO₂.

The heat of adsorption of an amine-based solid adsorbent depends upon the amine type, molecular weight and adsorption conditions. However, this parameter has not received adequate attention by experimental studies as it is often theoretically estimated by different models [19,30,31,32]. Working capacities may have been over-estimated by some calculations without considering the regeneration conditions [29,33]. Process related parameters, such as the heat recovery of the sensible heat, are not included in Eq. (1) while a sensible heat recovery ratio of 90% is assumed in most MEA technologies. Hedin et al. [34] have reviewed the adsorbents for post-combustion capture using rapid Temperature Swing Adsorption (TSA) and emphasized that the heat integration of the adsorption-driven processes with the power plant is crucial in ensuring the economy of the CO₂ capture technology. Besides, the effect of moisture co-adsorption on the regeneration heat has not been considered by many previous investigations [17,26,33] except the recent study by Quang et al. [28] who found that the regeneration heat increased significantly from 2.1 GJ/tCO₂ to 4.2 GJ/tCO₂ when the moisture uptake increased from 3 to 10 wt%.

The value of regeneration heat is a primary parameter for process designs including regenerator and steam extraction system. An accurate calculation of regeneration heat is essential to justify the advantages of a solid adsorbent system over the traditional MEA technology in terms of energy efficiency. It needs a comprehensive understanding of not only the physical properties of the

solid adsorbent but also the process-related parameters linked to a specific process design. The methodologies adopted by the previous investigations to calculate the regeneration heat have certain deficiencies in determination of the material characteristics and process-related parameters. A theoretical guidance is crucial to compare the impacts of all the parameters on the regeneration heat and to direct how to reduce the energy penalty more efficiently. In this study, a thermal energy balanced equation has been first proposed to clarify and re-evaluate the regeneration heat by using clearly defined working capacity, inclusion of moisture co-adsorption and the degree of heat recovery. TGA and Differential Scanning Calorimetry (DSC), as well as theoretical modelling, have been applied to determine the characteristics of the material. Several process-related parameters have also been verified in a purpose-built laboratory scale fluidized bed reactor using kg scale adsorbent. To the best of our knowledge, a sensitivity analysis of various parameters on the regeneration heat has been carried out for the first time to further elaborate the uncertainties arising from the current limited knowledge. This study demonstrates that not only working capacity, but also the moisture adsorption and the degree of heat recovery are the most influential factors affecting the regeneration heat for the PEI/silica adsorbent based system investigated.

2. Thermal energy requirement for regeneration

The regeneration heat has a crucial impact on the CO₂ capture cost and therefore is regarded as the most important criterion to evaluate the economic performance of a commercial scale CO₂ capture plant. In principle, it comprises the sensible heat which is necessary to bring the adsorbent from the adsorption temperature to the regeneration temperature in TSA technologies; the latent heat of desorption of which absolute value equals to the heat of adsorption and which is needed to overcome the chemical bonding strength between the adsorbed CO₂ and the adsorbent; and thirdly the latent heat which is induced by vaporization of water in the solvent or moisture in the adsorbent. The calculation of regeneration heat for a solid adsorbent based system using TSA technology can accordingly be revised from Eq. (1) and expressed as:

$$Q_r = \frac{1 - \alpha}{q_w} C_{p,s} (T_{de} - T_{ad}) + (1 - \beta) \Delta H_a + (1 - \gamma) \frac{Q_v f_{H_2O}}{q_w} \quad (2)$$

where Q_r (kJ/mol) is the regeneration heat requirement; q_w (mmol/g) is the working capacity of the adsorbent under given working conditions; α , β , γ are the fractions of heat recovery from sensible heat, heat of adsorption and vaporization heat respectively which can be realized through proper process designs; $C_{p,s}$ (kJ/kg K) is the specific heat capacity of the adsorbent; T_{ad} and T_{de} (K) are the temperatures of adsorption and desorption processes respectively; ΔH_a (kJ/mol) is the absolute value of heat of adsorption; Q_v (kJ/kg) is the vaporization heat of water which equals to 2257.6 kJ/kg at atmospheric pressure; and f_{H_2O} is the moisture uptake in the adsorber (i.e. H₂O adsorbed simultaneously with the CO₂ adsorption which will be evaporated in the regenerator at regeneration temperatures higher than 373 K at atmospheric pressure). Among the parameters in Eq. (1), some are physical properties of the adsorbents such as $C_{p,s}$ and ΔH_a , some are operational parameters related to the specific designed process such as α , β and $T_{de} - T_{ad}$ while others are determined by both the adsorbent characteristics and process design such as q_w and f_{H_2O} .

The authors have developed a PEI/silica based adsorbent and used this adsorbent for the following experimental research and parametric analysis. All variables involved in Eq. (2) have been theoretically or experimentally investigated in this study so that the advantage of this adsorbent based capture system in terms of

regeneration heat requirement can be quantified and compared with those of MEA based systems.

3. Experimental section

3.1. Materials

The adsorbent used in this study was synthesised by impregnating different mass ratios of 40%, 50%, 60% PEI (supplied by Sigma-Aldrich, UK) into an inorganic mesoporous silica support which has a BET surface area of approximately 250 m²/g, pore volumes of 1.7 cc/g and a mean pore diameter of approximately 20 nm [15]. PEIs of two molecular weights (MW), 1800 and 600, have been used for the preparation of the adsorbent. A 20 kg quantity of the PEI/silica adsorbent with a 40% mass ratio of PEI to silica and having a MW of 1800 of PEI was produced in collaboration with an industrial partner for the fluidized bed tests while small quantities containing different PEI mass ratios with varying MWs were prepared by the authors in the laboratory for TGA and DSC measurements. Details of characterization of the PEI/silica adsorbent by TGA, NMR, DRIFT, XPS and a fluidized bed reactor can be found in previous publications [14,15,20,21].

3.2. TGA testing

To measure the CO₂ uptake, a TGA (TA Q500 model) was used to assess the adsorption capacity with small amounts of sample (20–30 mg).

3.2.1. Isothermal tests

In a typical isothermal TGA test, the sample was heated up to 383 K in N₂ to desorb any pre-adsorbed CO₂ and moisture. The sample was then cooled down to the desired adsorption temperature when a mixture of CO₂ and N₂ was fed to the TGA furnace. The uptake of CO₂ by the adsorbent sample was determined by the mass increase during the adsorption stage. Five different gas mixtures containing 5%, 15%, 30%, 50% and 100% CO₂ balanced with N₂ were used for the isothermal tests. The adsorption of N₂ on the PEI/silica adsorbent can normally be neglected under the experimental conditions used. The adsorption temperature was selected as 343 K since the specific PEI/silica adsorbent performs best at this temperature as determined previously [21].

3.2.2. Isobaric tests

In order to reveal the dependence of CO₂ uptake on the adsorption temperature for a given CO₂ partial pressure, TGA measurements using slow heating rate (0.1 K/min) under isobaric conditions have been carried out to derive the pseudo-equilibrium capacities. These tests were run from ambient temperature to 423 K. One CO₂/N₂ gas mixture (15% CO₂) and pure CO₂ were used for two sets of isobaric tests to simulate the gas compositions for adsorption and desorption processes, respectively.

3.2.3. Cyclic adsorption tests

To investigate the cyclic performance and the thermal stability of the PEI/silica adsorbent, a series of 50 continuous cycles has been carried out in the TGA. Each cycle includes an adsorption process at 343 K with 15% CO₂ balanced by N₂, and a desorption process with pure N₂ as the sweep gas. The temperature of the TGA furnace was swung between the adsorption and desorption temperatures for each cycle. Two temperatures, 393 and 403 K, were used for desorption to ascertain the temperature effect on the thermal degradation. No moisture was present during both adsorption and desorption in these cyclic tests.

3.2.4. Moisture adsorption tests

The moisture content of actual flue gas in coal-fired power plant is typically 8–10 vol%. When the dry adsorbent is returned to the adsorber after regeneration, moisture adsorption may occur at the same time as CO₂ adsorption. In order to assess the moisture adsorption capacity and its effect on the CO₂ adsorption, the TGA has been modified to be able to introduce a controlled level of moisture into the furnace. The carrier gas was first diverted into a saturator which was immersed in a temperature controlled water bath. Then the carrier gas was redirected back into the TGA furnace through a heated line without condensation. The adsorption temperature for both moisture and CO₂ adsorption in the TGA furnace is 343 K. After PEI/silica adsorbent was dried at 383 K for half an hour, humidified N₂ containing around 9 vol% of moisture (RH = 30%) was fed into the TGA furnace until the sample was saturated with moisture. Subsequently, a mixture of 15% CO₂ and the same amount of moisture balanced by N₂ was fed into the TGA for co-adsorption of moisture and CO₂ until they were both saturated. Three continuous cycles have been conducted to check the repeatability.

3.3. DSC measurements

The DSC measurements have been carried out using an advanced SENSYS evo TG–DSC instrument which was manufacturer calibrated before the use. This instrument provides accurate sensors around the reactor furnace, together with a symmetrical microbalance to give combined TG and DSC signals for simultaneous measurements of the mass change and heat flow during adsorption. The heat of adsorption can then be derived in terms of the heat released per mole of CO₂ adsorbed. The experimental procedure is basically similar to that used in the isothermal TGA tests. The effects of PEI loading, molecular weight, adsorption temperature and CO₂ partial pressure on the heat of adsorption have been evaluated by using various samples under different adsorption conditions.

Before specific heat capacities of the PEI/silica adsorbents were determined, a blank test was first conducted with the empty crucible. Samples were dried at 383 K with N₂ for half an hour prior to the continuous C_p measurements where the furnace temperature is slowly increased from 303 to 403 K at a heating rate of 1 K/min.

3.4. Fluidized bed testing

A Bubbling Fluidized Bed (BFB) reactor was designed and manufactured for the purpose of investigating CO₂ capture from simulated flue gas mixtures using solid adsorbents. An electrically heated moisture saturator with separate temperature controls is used to generate the desired level of moisture for the adsorption and desorption. Up to 2 kg of PEI/silica adsorbent was loaded into the BFB reactor for continuous 60 cycles of adsorption and desorption tests. The adsorption was conducted at 343 K with 15% CO₂ balanced by N₂ while the desorption was conducted at 403 K with pure N₂ as the sweep gas. Dry simulated flue gas as well as humidified flue gas containing around 8.8 vol% moisture were used to evaluate the moisture effect on the cyclic performance of the PEI/silica adsorbent. More details of the fluidized bed tests can be found in Zhang et al. [21].

4. Parametric analysis of factors affecting regeneration heat

4.1. Heat of adsorption ΔH_a

The magnitude of the heat of adsorption can be estimated from either various equilibrium models or by direct calorimetry

measurement. An atomistic modelling of CO₂ chemisorption in aqueous solutions of primary and tertiary amines using DFT (Density Functional Theory)-based quantum chemical solvation has revealed that the heat of absorption is around 80 kJ/mol during carbamate formation and around 65 kJ/mol during bicarbonate formation [35]. By using a 2-L reaction calorimeter, Kim and Svendsen [36] measured the heat of absorption of CO₂ with aqueous MEA to be around 80–85 kJ/mol at 313 K, 90–95 kJ/mol at 353 K and 100–110 kJ/mol at 393 K.

There have also been some measurements or estimation of the heats of adsorption for various amine-based solid sorbents in the literature as summarized in Table 1.

According to the references cited in Table 1, the heats of adsorption of amine-based solid adsorbents vary over a wide range from around 40 to 90 kJ/mol, depending on the amine type, substrate type and immobilization methodology.

4.1.1. Langmuir isothermal equations fit

At equilibrium, the chemical adsorption of CO₂ on a solid adsorbent can be modelled using Langmuir isothermal adsorption equation [41]:

$$\theta = \frac{q}{q_{sat}} = \frac{b(T)p}{1 + b(T)p} \quad (3)$$

where θ is the fraction of the surface covered by CO₂ molecules, q (mmol/g) is the adsorption capacity while q_{sat} (mmol/g) represents the saturated amount of adsorption when the solid surface is fully covered by one layer of CO₂ molecules. p (bar) is the partial pressure of CO₂. b (bar⁻¹), the affinity coefficient between CO₂ and the adsorbent, is dependent on temperature T (K) as follows:

$$b(T) = b_0 \exp\left(\frac{\Delta H_a}{RT}\right) \quad (4)$$

where b_0 (bar⁻¹) is the pre-exponential constant for the affinity coefficient, ΔH_a (kJ/mol) is the absolute value of heat of adsorption and R is the universal gas constant (8.3145 J/mol K).

Eq. (3) can be re-written as follows so that the parameters of q_{sat} and b can be obtained by regression from experimental data:

$$\frac{p}{q} = \frac{1}{b(T)q_{sat}} + \frac{1}{q_{sat}}p \quad (5)$$

Table 1
Heat of adsorption for various amine-based solid sorbents.

Ref.	Types of solid adsorbents	ΔH_a (kJ/mol)	Methodology
Knowles et al. [30]	Functionalized mesoporous silica with 3-aminopropyltriethoxysilane	60	Calculated
Gray et al. [17]	Immobilized PEI on polystyrene (PS), silicon dioxide (SiO ₂) and polymethyl-methacrylate (PMMA) based substrates	43–63	Measured
Belmabkhout and Sayari [31]	Mesoporous silica based TRI-PE-MCM-41	90	Calculated
Sun et al. [37,38]	Impregnation of as-purchased MEA onto TiO ₂	81	Model fitted
Ebner et al. [19]	PEI immobilized into a CARiACT G10 silica substrate	50	Model fitted
McDonald et al. [39]	Alkylamine-appended metal-organic framework	61	Calculated
Li et al. [29]	Branched and linear PEIs on silica base	64–71	Measured
Mebane et al. [40]	Mesoporous silica supported amine	61	Calculated
Spenik et al. [25]	Immobilized amine on a mesoporous silica	66	Data fitted

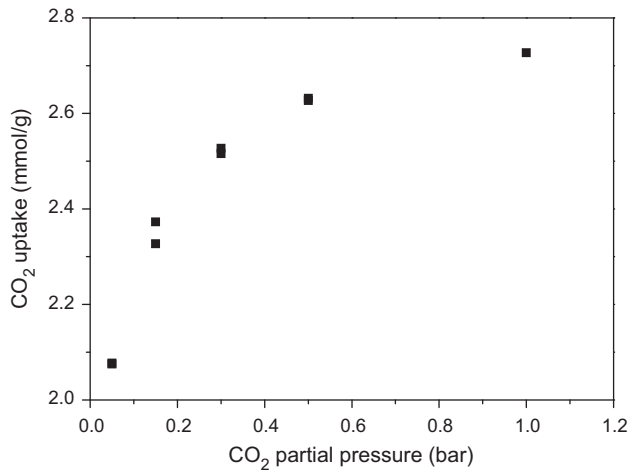


Fig. 1. TGA results of CO₂ uptake using various CO₂ partial pressures for PEI/silica adsorbent (isothermal at 343 K).

Fig. 1 illustrates isothermal CO₂ uptakes at 343 K at CO₂ partial pressures of 0.05, 0.15, 0.3, 0.5, 1 bar for the PEI/silica adsorbent determined by TGA. **Fig. 2** shows the linear fit of these TGA data to the Langmuir isothermal Eq. (5). This linear fit implies that the Langmuir equation can provide a good representation of the CO₂ adsorption thermodynamics for the PEI/silica adsorbent, in agreement with Fauth et al. [42]. The two parameters in Eq. (5) can then be determined by the linear function shown in **Fig. 2**.

$$q_{sat} = 2.78 \text{ mmol/g}, b(343) = 40.23 \text{ bar}^{-1}$$

Fig. 3 illustrates a typical plot of isobaric CO₂ uptake for the PEI/silica adsorbent under 0.15 bar CO₂ partial pressure. The CO₂ uptake reaches its peak value at around 340 K and drops to its minimum value at around 397 K. The observed CO₂ uptake at temperatures above 397 K is attributed to the formation of secondary urea groups, as suggested by Drage et al. [15], leading to the irreversible loss of CO₂ capacity. The existence of such a maximum adsorption uptake has also been verified by a number of researchers for various amine based adsorbents [16,43,44]. However, based on Eqs. (3) and (4), an increase of temperature will lead to a lower adsorption capacity. This is true when the adsorption behavior is only controlled by thermodynamics as the adsorption of CO₂ on solid surface is obviously an exothermic reaction. Diffusion control may

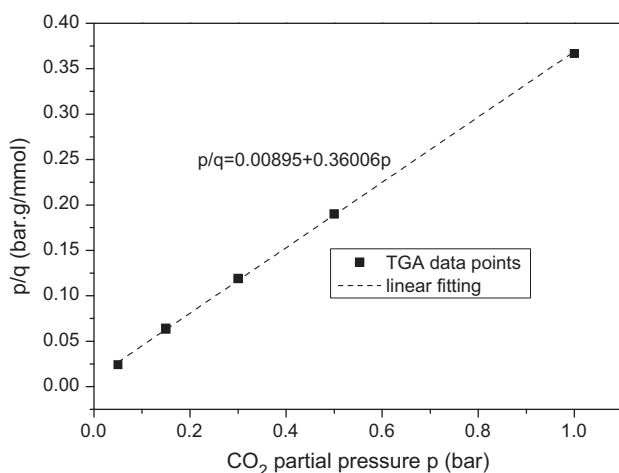


Fig. 2. Linear fitting of TGA data to Langmuir isothermal equation.

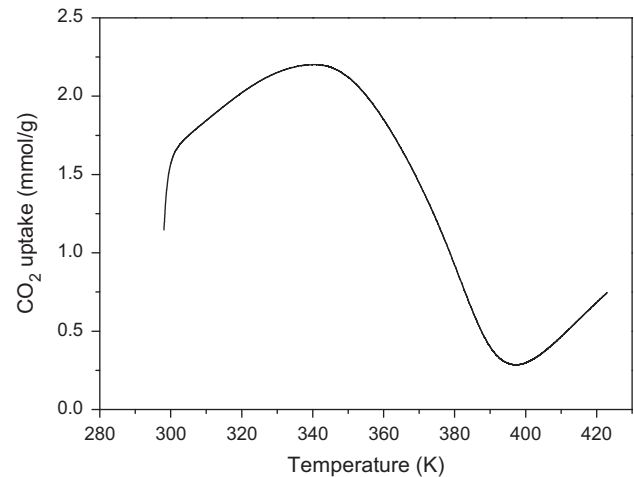


Fig. 3. Isobaric CO₂ uptake with temperature for the PEI/silica adsorbent (0.15 bar CO₂ partial pressure, 0.1 K/min of heating rate).

be dominant, especially at temperatures below 343 K. The maximum adsorption capacity is most likely to be a compromise between diffusion and thermodynamically controlled mechanisms.

Eq. (4) can be further re-written as:

$$\ln(b) = \ln(b_0) + \frac{\Delta H_a}{R} \cdot \frac{1}{T} \quad (6)$$

As shown in **Fig. 4**, the slow heating results by TGA (**Fig. 3**) can be fitted by a linear function. The temperature range of 353–393 K, which is believed to be under thermodynamic control as explained earlier, is selected for the data fitting. Based on the interception and slope of the linear function, it can be derived that:

$$b_0 = 1.976 \times 10^{-12} \text{ bar}^{-1}, \Delta H_a = 88.4 \text{ kJ/mol}$$

4.1.2. DSC measurements

In order to obtain more accurate data on the heat of adsorption and also to verify the validity of Langmuir isothermal models, the heats of adsorption for the PEI/silica adsorbent have been measured by the instrument SENSYS evo TG-DSC.

PEI/silica adsorbents of three PEI loadings (40%, 50% and 60%) and two MWs (1800 and 600) have been tested at three adsorption temperatures (298, 323 and 343 K) and two CO₂ concentrations

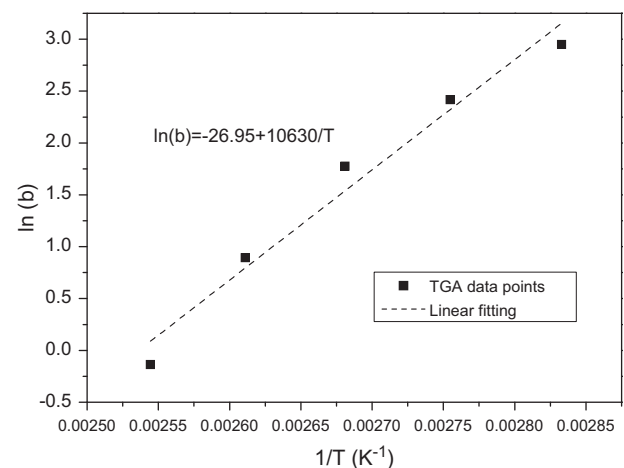


Fig. 4. Linear fitting of b_0 and ΔH_a using TGA results for the PEI/silica adsorbent (CO₂ partial pressure: 0.15 bar).

(5% and 15%). The samples used in the DSC measurements are denoted as PEI'W'-MW'X'-R'Y'-Z'K, where W denotes the PEI loading, X denotes the molecular weight, Y denotes the CO₂ concentration and Z denotes the adsorption temperature. Three repeat tests were conducted on the sample PEI40-MW1800-R15-343K and the results were 93.7, 95.0, and 95.5 kJ/mol, indicating that the measurement errors were within the range of $\pm 1.5\%$.

As indicated in Fig. 5, it is clear that the heats of adsorption are higher at elevated temperatures, which is in agreement with the temperature dependence identified for MEA by Kim and Svendsen [36]. Adsorbents with higher PEI loadings seem to have higher heats of adsorption, especially at the lowest adsorption temperature of 298 K. PEI/silica samples with the same MW of 1800 but different PEI loadings and different adsorption temperatures show higher values of heat of adsorption in 15% CO₂, compared to the lower concentration of 5% (Fig. 6). By comparing a pair of samples PEI40-MW600-343K and PEI40-MW1800-343K, or the pair of PEI40-MW600-323K and PEI40-MW1800-323K under 15% CO₂, it is apparent that the lower MW PEI has the higher heat of adsorption which might be due to the higher content of primary amine groups in the lower MW sample (600). This is in agreement with the findings on the heat of adsorption for PEI/silica adsorbents with different MW reported by Li et al. [29]. For all samples, the measured heats of adsorption by TG-DSC in this study fall within the range of 85–103 kJ/mol, which is comparable to the value for 30% aqueous MEA (92 kJ/mol at 353 K) measured by Kim and Svendsen [36] but is higher than most of the reported results shown in Table 1. High heat of adsorption provides the potential for high CO₂ adsorption capacity over a wide range of operating conditions and system designs such as for capturing CO₂ directly from ambient air [20] but it also brings the associated disadvantage of high energy requirements for releasing the CO₂ during regeneration.

4.2. Specific heat capacity $C_{p,s}$

Heat capacity of a specific sorbent/solvent is an essential parameter for the process design in calculating the heat duty in the regenerator and the heat flux in the heat exchangers for recovering the sensible heat contained in the hot sorbent/solvent. In a typical aqueous MEA based absorption system, the sensible heat can account for up to 40% of the total regeneration heat [45], mainly due to the large amount of water present. By replacing aqueous amines with solid sorbents, the heat capacity can be greatly reduced. Yang and Hoffman [46] adopted the value of

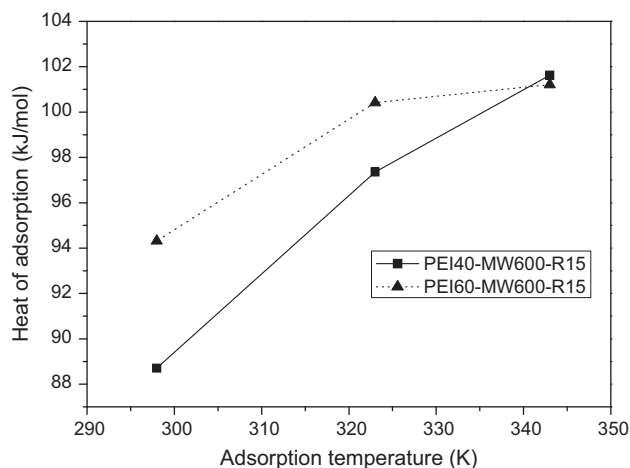


Fig. 5. Effect of temperature on heat of adsorption for samples with different PEI loadings.

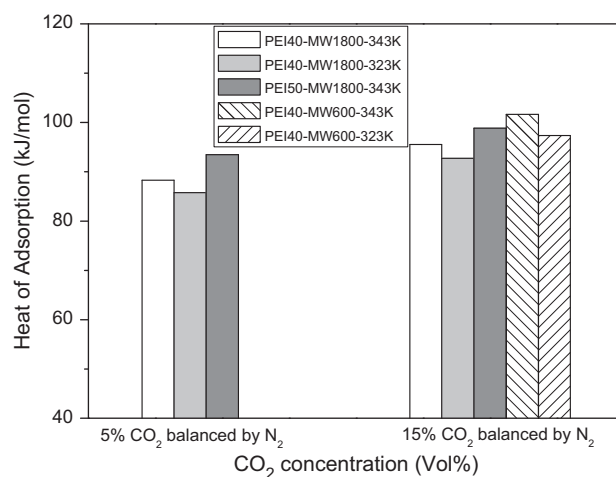


Fig. 6. Effect of CO₂ concentration on heat of adsorption for PEI/silica samples with different molecular weights and adsorption temperatures.

1.926 J/g K for the specific heat capacity of solid sorbents used in their exploratory design study on reactor configurations. Pirngruber et al. [32] estimated a value of 1.25 J/g K for the PEI based solid sorbents in a theoretical analysis of the energy consumption of post-combustion CO₂ capture processes. More recently, Quang et al. [28,47] used a micro-reaction calorimeter to measure the heat capacities of precipitated silica-based solid sorbents impregnated with various types of amines over the temperature range of 303 to 363 K, with moisture content varying from 0% to 15%.

The temperature-dependant specific heat capacities of the PEI/silica adsorbent have been determined by TG-DSC and the results are illustrated in Fig. 7 and compared with the reference data from Quang et al. [28]. The heat capacities of sample PEI40-MW1800 tend to increase as temperature increases from 303 to 383 K, which is in accordance with previous studies on the heat capacities of amine systems [28,48,49]. The values are considerably lower than that for 30 wt% MEA solvent which is around 4.0 J/g K. The PEI-PS-60 in Ref. [28] which has a higher PEI loading of 60% has a higher value of heat capacity, owing to the higher heat capacity of PEI comparing to silica. The C_p data between the adsorption and desorption temperature (which are about 343 K and 403 K respectively) are more important as the sensible heat are calculated in this temperature window. According to the DSC results, the average specific heat capacity for sample PEI40-MW1800 within the temperature range of 343–403 K is around 1.81 J/g K.

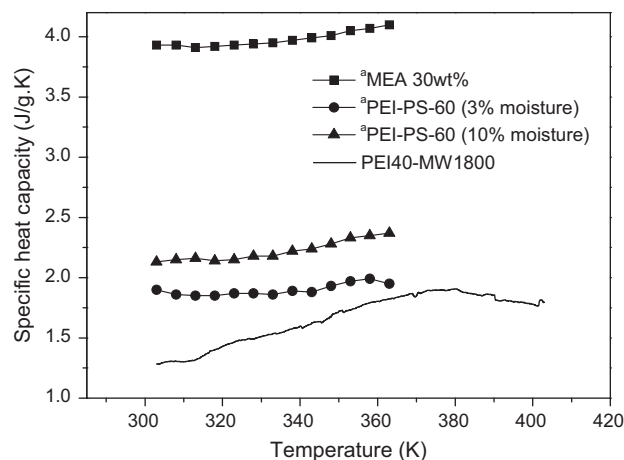


Fig. 7. DSC measurements of specific heat capacity of PEI40-MW1800 and comparison with reference data (a) data from [28]).

4.3. Temperature swing difference $T_{de} - T_{ad}$

The dependence of adsorption capacities on temperature, as revealed in Fig. 3, makes it possible to regenerate PEI/silica adsorbents by TSA where the adsorption temperature is T_{ad} and the desorption temperature is T_{de} . A number of researchers have proposed an optimum adsorption temperature T_{ad} of around 343 K for PEI impregnated solid adsorbents [16,21,43,44]. As the magnitude of sensible heat is proportional to the temperature difference, from this viewpoint, selection of as low as possible T_{de} is beneficial in requiring less regeneration heat, assuming that this selection will not cause a significant decrease in working capacity q_w . More importantly, PEI impregnated adsorbents suffer from serious thermal degradation when they are exposed to high desorption temperature for long periods of operation, probably due to the formation of urea groups especially in the absence of moisture. Fig. 8 shows the TGA results of continuous 50 dry cycles for the PEI/silica adsorbent using two desorption temperatures of 393 and 403 K. After 50 cycles, the PEI/silica adsorbent has suffered a relative loss of 15% from their initial adsorption capacity using 403 K as the desorption temperature, comparing with a lower loss of 7.7% under 393 K.

On the other hand, the endothermic nature of desorption implies that a higher temperature is favorable to obtain more complete desorption at a higher rate. This is beneficial to achieve a high working capacity. In addition, solids residence time in the regenerator can be largely reduced with higher desorption rates, which in turn can reduce the inventory solid mass, the reactor dimension and the corresponding capital and operational costs. The thermal degradation of PEI/silica adsorbents at 403 K can be effectively alleviated by introducing a certain amount of moisture during adsorption and desorption. Fig. 9 shows the adapted results from previous work on a fluidized bed reactor for evaluating the cyclic performance of the PEI/silica adsorbent [21]. The normalized CO_2 adsorption capacity is defined as a dimensionless factor by dividing the capacity of any cycle to the initial capacity of the first cycle. Introduction of around 8.8 vol% of moisture, which is a similar level of moisture present in the real flue gas from coal-fired power plants, has been proved to be able to stabilize the adsorption capacity after a total number of 60 cycles.

Therefore, the desorption temperature needs to be carefully selected by considering a number of factors including sensible

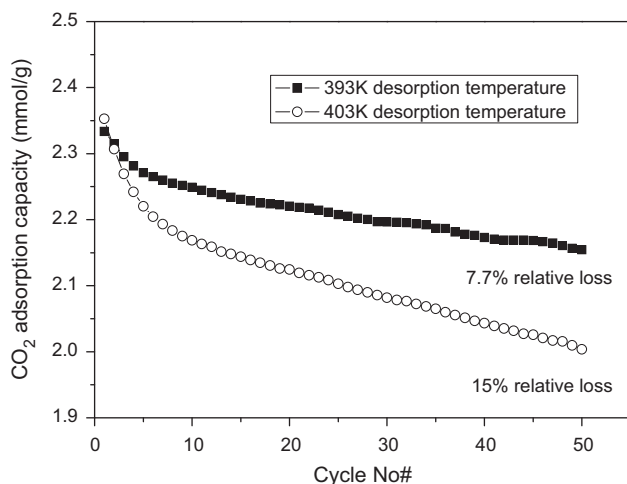


Fig. 8. Cyclic CO_2 adsorption capacities of the PEI/silica adsorbent under 393/403 K desorption temperature by TGA (adsorption at 343 K with 15% CO_2 balanced with N_2 , desorption conducted with pure N_2 as sweep gas, no moisture present during adsorption and desorption).

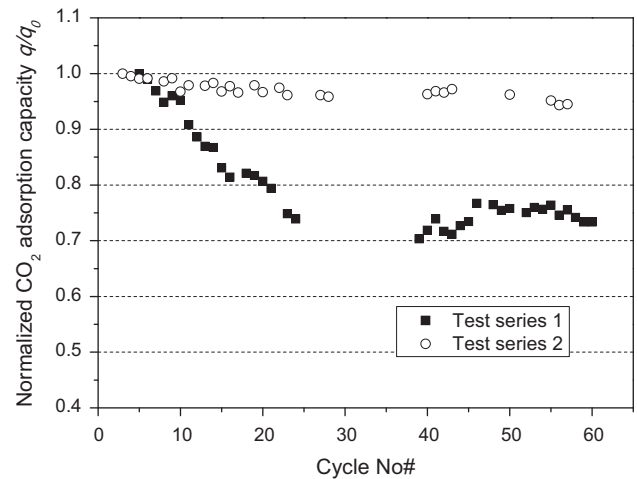


Fig. 9. Cyclic normalized CO_2 adsorption capacities of PEI/silica adsorbent obtained from the fluidized bed tests (adsorption at 343 K with 15% CO_2 balanced with N_2 , desorption at 403 K with pure N_2 as sweep gas. Test series 1: first 24 cycles without moisture while all the following cycles with 8.8 vol% moisture; Test series 2: 8.8 vol% moisture was present from the first cycle. Data adapted from previous publication [21]).

heat, thermal degradation, working capacity, desorption rate and moisture effect. In this study, T_{ad} is selected as 343 K and T_{de} is selected as 403 K, giving a temperature swing difference of 60 K.

4.4. Working capacity q_w

The equilibrium CO_2 adsorption capacity, determined by TGA under isothermal conditions, is usually regarded as an indicator to evaluate the performance of a specific solid sorbent. For a practical application, the solid sorbents are being circulated continuously between the adsorber and the desorber. The term of “working capacity q_w ” can be defined as the difference between the CO_2 loading at the end of the adsorption stage and the CO_2 loading at the end of desorption stage, i.e.

$$q_w = q_{ad} - q_{de} = q_{sat} \left(\frac{b(T_{ad})p_{ad}}{1 + b(T_{ad})p_{ad}} - \frac{b(T_{de})p_{de}}{1 + b(T_{de})p_{de}} \right) \quad (7)$$

where p_{ad} and p_{de} are the CO_2 partial pressure for adsorption and desorption, respectively.

Although nitrogen was used as the sweep gas during desorption in our previous studies using TGA and the fluidized bed [20,21], it is impractical to use the same regeneration strategy as the product gas needs to have a high purity of CO_2 for further compression and storage. Using pure CO_2 as the sweep gas during desorption can yield high purity CO_2 . However, this may result in serious thermal degradation and lower working capacities [15,24,50]. Pure steam has also been proposed as the sweep gas [17,51] to alleviate thermal degradation at the cost of a higher thermal energy penalty and additional devices for water condensation from the desorbed CO_2 stream. In addition, long periods of exposure to steam may decrease the CO_2 uptake of PEI/silica adsorbents as observed in recent studies [50,52,53]. Therefore, regeneration strategies using steam as the sweep gas still need further investigation. In the following analysis, pure CO_2 is proposed as the sweep gas.

Fig. 10 shows a series of Langmuir isothermal curves at different temperatures. The parameters in the Langmuir model are adopted from the calculations in Section 4.1.1 ($\Delta H_a = 88.4$ kJ/mol, $q_{max} = 2.78$ mmol/g, $b_0 = 1.976 \times 10^{-12}$ bar $^{-1}$). This figure can be used to predict the working capacity under certain working conditions. For example, if the adsorption is conducted at 343 K with 15% CO_2 present in the flue gas (corresponds to point A in

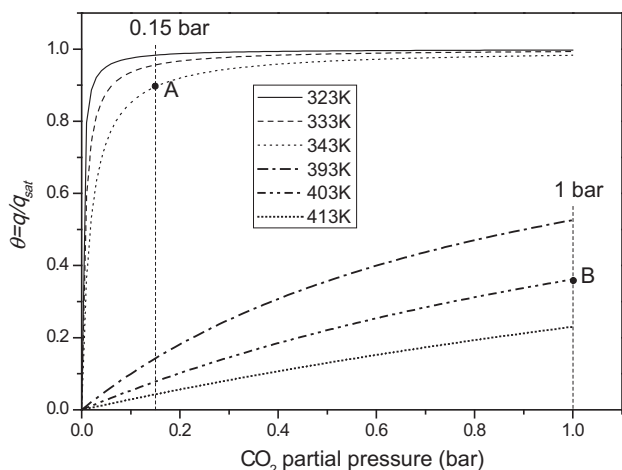


Fig. 10. Langmuir model predictions of working capacity for PEI/silica adsorbents ($\Delta H_a = 88.4$ kJ/mol, $q_{max} = 2.78$ mmol/g, $b_0 = 1.976 \times 10^{-12}$ bar $^{-1}$, values adopted from Section 4.1.1).

Fig. 10) and the desorption is conducted at 403 K with pure CO₂ as the sweep gas (corresponds to point B in Fig. 10), the difference between points A and B is: $\Delta\theta = 0.534$, which gives a working capacity of $q_w = 1.48$ mmol/g.

The working capacity of the PEI/silica adsorbent can also be estimated from the pseudo-equilibrium capacities obtained from TGA isobaric tests. Fig. 11 shows one case where adsorption is conducted at the optimum temperature of 340 K with 15% CO₂ (corresponds to point A) while desorption is conducted at 403 K with lowest CO₂ uptake using pure CO₂ as the sweep gas (corresponds to point B). The difference in CO₂ uptake between points A and B can be considered as the working capacity and is estimated as 1.35 mmol/g.

The estimated working capacity in this case is around 60% of the maximum CO₂ uptake at 340 K under 15% CO₂. A higher working capacity means that less amount of adsorbent is required for CO₂ adsorption for a given amount of CO₂ to be captured, leading to less sensible heat requirement and also less electrical energy to physically circulate the adsorbent between adsorption and desorption reactors. Therefore, the optimal working conditions of adsorption and regeneration strategies need to be further investigated to obtain as high working capacity as possible.

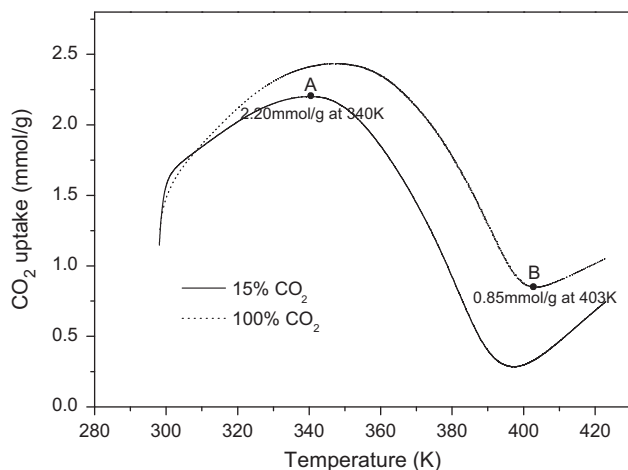


Fig. 11. Estimation of working capacity using pseudo-equilibrium capacities obtained from the isobaric TGA tests (adsorption at 340 K with 15% CO₂ and desorption at 403 K with pure CO₂ as the sweep gas).

4.5. Moisture adsorption f_{H_2O}

Amine based solid sorbents normally contains a number of hydrophilic silanol and amino groups which have a strong affinity to water. They can adsorb moisture from humid surroundings at room temperature and therefore usually contain a certain amount of moisture. Further, moisture adsorption can occur in the adsorbent when the adsorbent is in contact with the real flue gas containing a certain level of moisture (typically 8–10 vol% for coal-fired power plants if the moisture has not been removed prior to entering the adsorbent). The moisture adsorbed during the time spent in the adsorbent increases the apparent heat capacity of the sorbents and more importantly results in additional requirement of vaporization heat during regeneration. There are only a few studies, such as Quang et al. [28], which have addressed the effect of moisture adsorption on the regeneration heat.

For the specific PEI/silica adsorbent investigated here, co-adsorption of moisture and CO₂ on the dry sample in TGA has been carried out and the results are shown in Fig. 12. The adsorption of moisture onto the adsorbent surface reached its equilibrium value of around 2 wt% after about 10 min for the PEI/silica adsorbent under the specific adsorption conditions. One can expect that this value will be lower when CO₂ is present due to competitive adsorption, or if the solids residence time in the adsorbent can be less than 10 min. It can also be seen that the subsequent CO₂ adsorption capacity has not been much affected by the pre-adsorption of moisture (around 10 wt%, i.e. 2.27 mmol/g, comparing to TGA result of 2.20 mmol/g in Fig. 11). The negligible effect of moisture co-adsorption on CO₂ uptake has also been verified by other researchers [50,54] and this may imply that there is little competition for adsorption sites between CO₂ and H₂O. Changes in adsorption conditions (such as moisture content in flue gas and the adsorption temperature) may significantly change the moisture adsorption capacity, especially when the relative humidity approaches 100% in the moisture saturated flue gas [54].

4.6. Heat recovery fractions α , β , and γ

The aqueous amine scrubbing technology has been commercialized and significant improvements have been made in terms of heat recovery, turbine and flow-sheet modifications. By improving the internal heat recovery in the steam and solvent circulation cycles for a coal-fired power plant, the efficiency penalty for amine scrubbing can be effectively reduced [55]. Optimized process configurations have also been proposed by Amrollahi et al. [56] for

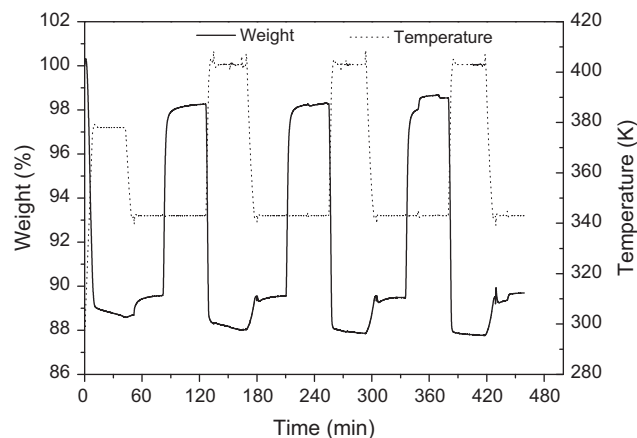


Fig. 12. Co-adsorption of moisture and CO₂ on dry PEI/silica adsorbent for continuous 3 cycles at 343 K in humidified carrier gas containing 9 vol% moisture.

natural-gas-fired power plant, which include improved technologies such as absorber inter-cooling and lean vapor recompression.

Comparing to the large number of studies on low temperature solid sorbent materials development aiming at achieving high adsorption capacities, process and system design and modelling as well as optimization have received little attention. Park et al. [57] recently proposed a multi-stage process configuration for large scale power plant carbon capture with solid adsorbents. Heat integration is realized by direct heat exchange between the hot and cold solid adsorbents and also by indirect heat exchange using heat transfer media. Additional heat recovery is realized from the exhaust gas streams coming from the cyclones. Following Park's work, Kim et al. [58–60] developed a process model to assess the economic feasibility of various process designs including moving bed, bubbling bed and fast fluidized bed applying amine based solid sorbents. A parameter, “degree of heat integration (DHI)”, was defined to evaluate the performance and energy efficiency of the whole system:

$$\text{DHI (\%)} = \frac{\text{Recovered thermal energy by heat integration}}{\text{Total regeneration energy w/o any heat recovery}} \times 100 \quad (8)$$

They concluded that the DHI value for the optimized multi-stage system can be enhanced up to 80%.

Thermal energy recovery from sensible heat, latent heat in both adsorbent and moisture is the most effective way to reduce the total regeneration energy requirement. The recovery ratio α of sensible heat is assumed to be 75% for the PEI/silica based capture system, the same as that suggested by Veneman et al. [33], which is lower than the value of 90% used for the lean/rich solvent heat exchanger in a typical aqueous MEA scrubbing process [56]. Due to the difficulty in recovering the heat of adsorption from the flue gas exiting the adsorber at low temperatures of around 343 K, recovery ratio β is assumed to be 0.25 for the nominal case. The recovery ratio γ of the vaporization heat is assumed to be 0.5 which can be technically realized by condensing the evaporated steam at the exit of the desorber.

5. Discussions on regeneration heat requirement

Nominal values of parameters in the calculation of regeneration heat for the PEI/silica adsorbent capture system are summarized in Table 2 based on the above parametric analysis. Values of heat of adsorption ΔH_a and heat capacity $C_{p,s}$ are adopted for the sample of PEI40-MW1800-R15-343K.

By substituting the nominal parameters into Eq. (2), the components of sensible heat, heat of adsorption, vaporization heat and the total regeneration heat are calculated for the PEI/silica CO₂ capture system and compared with the benchmark aqueous MEA 30% system. Results are included in Table 3 and illustrated in Fig. 13. It can be seen that the PEI/silica based system has a big advantage in

Table 2

Nominal parameters adopted for calculating regeneration heat for the PEI/silica based capturing system.

ΔH_a (kJ/mol)	95
$C_{p,s}$ (kJ/kg K)	1.81
ΔT (K)	60
q_w (mmol/g)	1.35
f_{H_2O}	0.02
α	0.75
β	0.25
γ	0.5

Table 3

Calculation of regeneration heat (GJ/tCO₂) for the PEI/silica based system compared with the benchmark aqueous MEA 30% system [28].

Types of heat	Benchmark 30% MEA system	PEI/silica CO ₂ capture system
Sensible heat	1.505	0.457
Heat of adsorption	1.932	1.619
Vaporization heat	0.462	0.380
Total regeneration heat	3.90	2.46

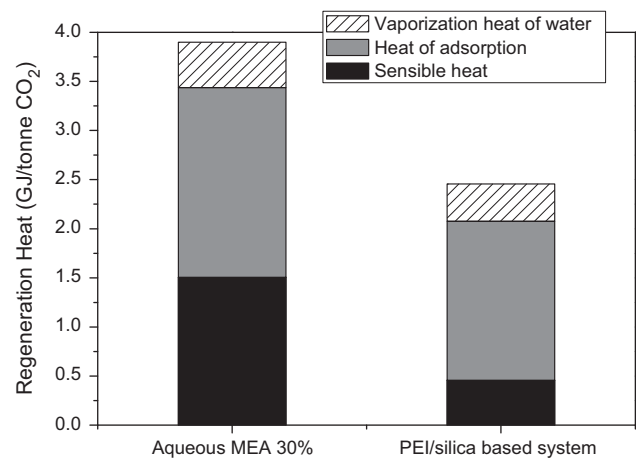


Fig. 13. Comparison of regeneration heat requirement for the PEI/silica CO₂ capture system with the benchmark 30% MEA system.

saving sensible heat, given the fact that the specific heat capacity of the solid sorbent is much lower than aqueous MEA. The other two components for the PEI/silica system, the heat of adsorption and vaporization heat, are slightly lower than the MEA system for the given recovery ratios listed in Table 2. In total, the regeneration heat for the proposed PEI/silica CO₂ capture system is 2.46 GJ/tCO₂, which represents a relative reduction of 37% from the value of 3.90 GJ/tCO₂ for the benchmark MEA system [28]. It is also 25% lower than the value of 3.30 GJ/tCO₂ which is adopted in this paper for the advanced and state-of-art MEA scrubbing technology, as proposed by Abu-Zahra et al. [6] and IEA [12].

Sensitivity analyses of the influence of all parameters on the value of regeneration heat have been conducted within varying ranges of the nominal values listed in Table 2 and the results are summarized in Fig. 14. It is assumed that all parameters are independent of each other although it may not be exactly true. For example, changes in heat of adsorption and the temperature swing difference may cause changes in working capacity. However, this effect has been ignored for simplicity with the sensitivity analysis.

Fig. 14(a) shows the effect of heat of adsorption on the regeneration heat. As the measurement results of heat of adsorption for the PEI/silica adsorbent by TG-DSC in this study are larger than most reported values, only negative variations up to –50% of the nominal value have been considered, which gives a much lower regeneration heat of 1.65 GJ/tCO₂. The regeneration heat is less sensitive to the specific heat capacity and swing temperature difference, as shown in Fig. 14(b) and (c). Relative variations in both $C_{p,s}$ and ΔT between $\pm 50\%$ have resulted in a relative variation of only $\pm 9\%$ in the regeneration heat. Within the variation ranges investigated, all values of regeneration heat for the solid sorbent capture system are lower than the advanced MEA system.

Increasing working capacity is regarded as one of the most effective ways to reduce the regeneration heat. As shown in

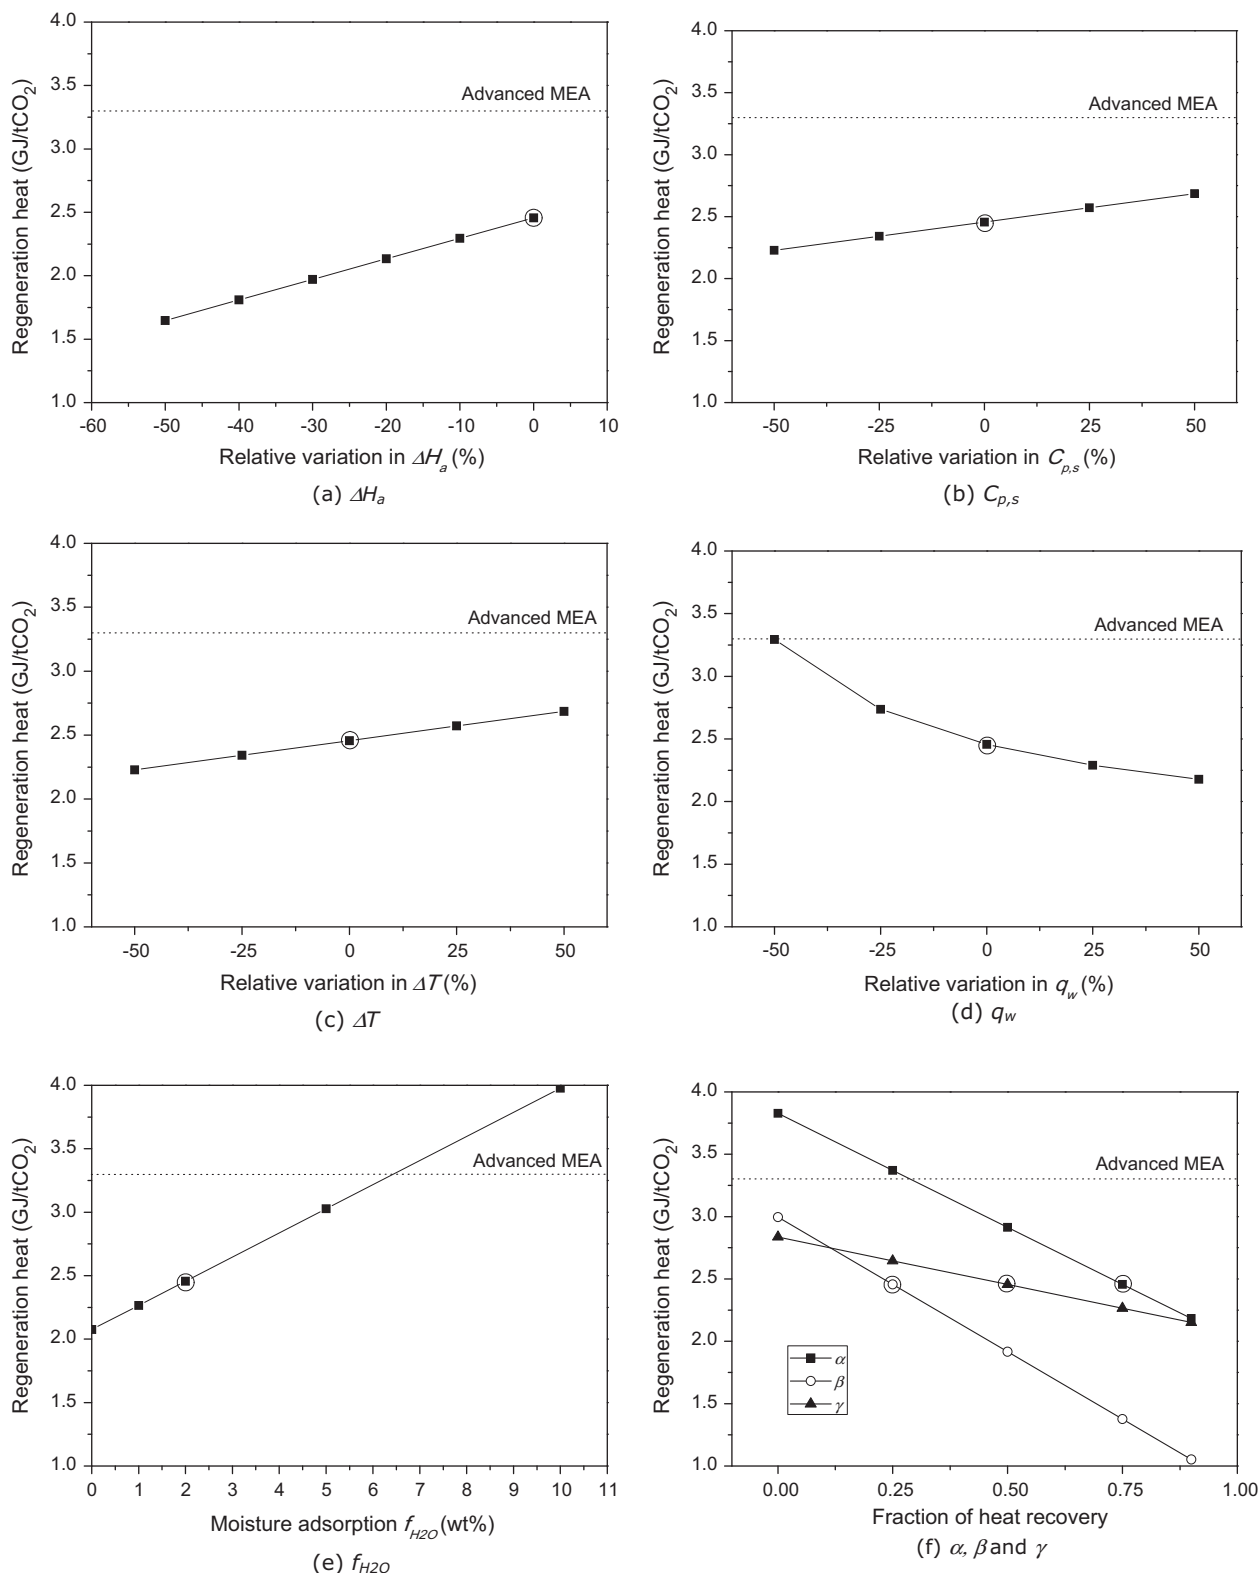


Fig. 14. Sensitivity analysis of parameters affecting the regeneration heat (data point within a circle denotes the value which corresponds to the nominal condition specified in Table 2).

Fig. 14(d), 50% improvement on the working capacity (from 1.35 to 2.025 mmol/g) only gives a relative reduction of 11% in the regeneration heat (from 2.46 to 2.18 GJ/tCO₂). When the working capacity is as low as 0.675 mmol/g, which is a 50% relative reduction, the calculated regeneration heat is much higher and it is comparable to the advanced MEA system.

The amount of moisture adsorbed has a significant effect on the regeneration heat if all of the adsorbed moisture is assumed to be vaporized as steam in the desorber. For an absolute reduction of the moisture adsorption from 2 wt% to zero as shown in Fig. 14 (e), the regeneration heat is reduced to 2.08 GJ/tCO₂, which represents 15.5% reduction. This implies that eliminating moisture

adsorption is more effective than improving the working capacity by 50% for reducing the regeneration heat. If moisture adsorption reaches 10 wt%, the calculated regeneration heat would have exceeded the regeneration heat requirement of the baseline MEA system. Therefore, it is vital to effectively control the moisture adsorption in the adsorber, for example, by necessary surface modifications, or by controlling the solid residence time in the adsorber. Additional heat recovery facilities on the CO₂ stream leaving the desorber is also essential to recover the condensation heat of the evaporated steam.

The degree of heat recovery from all heat components in Eq. (2) depends on proper process design. As shown in Fig. 14(f), the regeneration heat is reduced to 2.18 GJ/tCO₂ if 0.9 of the recovery ratio α can be realized as for the typical MEA system. The PEI/silica sorbent capture system will not show any advantages over advanced MEA systems if the sensible heat recovery ratio α is lower than 0.25. As the heat of adsorption contributes more than 60% of total regeneration heat, the value of regeneration heat can be vastly reduced down to 1.92 GJ/tCO₂ if the recovery ratio β can be improved up to 0.50. The improvement on increasing the heat recovery ratio γ is less significant as vaporization heat contributes least in the total regeneration heat. By assuming the nominal values of $\alpha = 0.75$, $\beta = 0.25$ and $\gamma = 0.5$, the calculated DHI from Eq. (8) is 61%, which is still much lower than the value of 80% concluded by Kim et al. [59,60] for their process design. This implies that by using energy efficient process designs such as the multi-stage fluidized bed process concept proposed by Kim et al. [59,60], the regeneration heat of 2.46 GJ/tCO₂ with the assumptions made in this study can be realized.

6. Conclusions and further discussion

Parametric analysis of various factors influencing the regeneration heat required for CO₂ capture using the PEI/silica adsorbent has been made in this study. A revised equation for calculating regeneration heat has been proposed to evaluate the effects of physical properties of the adsorbent as well as process related parameters. The proposed equation is based on a fundamental thermal energy balance and, therefore, it is applicable not only to the specific PEI/silica adsorbent in this study but also to all solid adsorbents based CO₂ capture systems using TSA technology. It provides a theoretical guidance for comparing the advantages of various solid adsorbents and different processes in terms of thermal efficiencies. As the regeneration heat represents the most important energy penalty for a practical power plant integrated with CCS facilities, the equation can be further used to evaluate the net plant efficiency penalties.

This paper has provided a case study based on the specific PEI/silica adsorbent and several assumed parameters. The calculated regeneration heat is 2.46 GJ/tCO₂ which is lower than 3.9 GJ/tCO₂ for a typical aqueous MEA system and is also lower than 3.3 GJ/tCO₂ for advanced MEA systems. To ensure the reliability of the results, most parameters in the equation have been verified by different means including TGA, DSC, measurements in a laboratory fluidized bed and theoretical modelling as well. The calculated regeneration heat is however higher than some reported values for amine based solid adsorbents [27,29]. This is mainly due to the fact that our measured heat of adsorption is higher than most reported values. The DSC measurements have revealed that the heat of adsorption is dependent on the amine loadings, molecular weight, adsorption temperature and CO₂ partial pressure. It can be expected that it is also dependent on the amine types as well. For a practical CO₂ capture application where CO₂ partial pressure can differ significantly, the heat of adsorption for the selected adsor-

bent should be carefully tailored to make a compromise between the energy penalties and capture efficiency and kinetics.

There are several uncertainties in the current parametric analysis as revealed by the sensitivity analysis. The first comes from the difficulty in estimating the working capacities accurately. Unlike the equilibrium CO₂ adsorption capacities which are achieved under ideal working conditions and long reaction time, the working capacities need to be determined in the context of a specific process where working conditions of both adsorption and desorption, solid residence times in both adsorber and desorber, regeneration strategies and cyclic performance all have crucial influences. Although this study has provided two means of estimation of the working capacities, more experimental work under simulated practical working conditions should be the future research emphasis. It should also be noted that the relationship between the regeneration heat and the working capacity is not linear. Further improvement on the working capacity (50% increase) can only give rise to a relatively small decrease in the regeneration heat (11%).

The second uncertainty comes from the moisture adsorption on the solid adsorbents. Although it is measured in this study that the moisture adsorption capacity for the PEI/silica adsorbent under the specified conditions is only 2 wt%, this may significantly increase if the relative humidity is higher or if the amine types have stronger water affinity. The solid adsorbent based CO₂ capture system will be economically unfeasible if the moisture adsorption capacity is as high as 10 wt%. For such a practical system, additional facilities or surface modification techniques should be in place to control the moisture adsorption.

The third uncertainty comes from the estimation of the heat recovery ratios although this study has assumed conservative values for these parameters. Improvement on the heat recovery can significantly reduce the regeneration heat. However, there have been very few studies on the designing and configuring of a practical or pilot scale process which can realize high integration of heat recovery except for the very recent publications such as Park et al. [57], Kim et al. [59,60], Veneman et al. [61], Schony et al. [62] and Proll et al. [63], although most of these are limited to theoretical or feasibility study.

Apart from materials development, investigations into the process related parameters should receive much more attention for practical carbon capture applications using solid adsorbents. These should include more experimental work on evaluating the working capacities in a specific process, restraining moisture co-adsorption in the adsorber and designing of the high degree heat integral processes and facilities. These priorities are believed to be of importance for the future demonstration and commercialization of CCS technology.

Acknowledgements

The authors wish to acknowledge the financial support of the UK Engineering and Physical Research Council (EPSRC, grant nos. EP/J020745/1 and EP/G063176/1).

References

- [1] EPA. <<http://www.epa.gov/climatechange/ghgemissions/gases/co2.html>> [accessed on March, 2015].
- [2] IPCC special report. In: Metz B, Davidson O, de Coninck H, Loos M, Meyer L, editors. Carbon dioxide capture and storage. Cambridge: Cambridge University Press; 2005.
- [3] Mondal MK, Balsora HK, Varshney P. Progress and trends in CO₂ capture/separation technologies: a review. *Energy* 2012;46:431–41.
- [4] Rochelle GT. Amine scrubbing for CO₂ capture. *Science* 2009;325:1652–4.
- [5] IEA. Improvement in power generation with post-combustion capture of CO₂. IEA Greenhouse Gas R&D Programme. Report Number PH4/33; November 2004.
- [6] Abu-Zahra MRM, Schneiders LHJ, Niederer JPM, Feron PHM, Versteeg GF. CO₂ capture from power plants: Part I. A parametric study of the technical

- performance based on monoethanolamine. *Int J Greenhouse Gas Control* 2007;1:37–46.
- [7] Han C, Graves K, Neathery J, Liu K. Simulation of the energy consumption of CO₂ capture by aqueous monoethanolamine in pilot plant. *Energy Environ Res* 2011;1:67–80.
 - [8] Chapel D, Ernest J, Mariz C. Recovery of CO₂ from flue gases: commercial trends. Canadian Society of Chemical Engineers annual meeting, Canada; October 4–6, 1999.
 - [9] Alie C, Backham L, Croiset E, Douglas P. Simulation of CO₂ capture using MEA scrubbing: a flowsheet decomposition method. *Energy Convers Manage* 2005;46:475–87.
 - [10] Singh D, Croiset E, Douglas P, Douglas M. Techno-economic study of CO₂ capture from an existing coal-fired power plant: MEA scrubbing vs. O₂/CO₂ recycle combustion. *Energy Convers Manage* 2003;44:3073–91.
 - [11] Li H, Ditaranto M, Yan J. Carbon capture with low energy penalty: supplementary fired natural gas combined cycles. *Appl Energy* 2012;97:164–9.
 - [12] IEA. CCS retrofit – analysis of the globally installed coal-fired power plant fleet. Paris: IEA/OECD; 2011.
 - [13] Goto K, Kodama S, Okabe H, Fujioka Y. Energy performance of new amine-based solvents for CO₂ capture from blast furnace gas. Recent advances in post-combustion CO₂ capture chemistry; 2012. p. 317–31 [chapter 17].
 - [14] Drage TC, Arenillas A, Smith KM, Pevida C, Piippo S, Snape CE. Preparation of carbon dioxide adsorbents from the chemical activation of ureaformaldehyde and melamine-formaldehyde resins. *Fuel* 2007;86:22–31.
 - [15] Drage TC, Arenillas A, Smith KM, Pevida, Snape CE. Thermal stability of polyethyleneimine based carbon dioxide adsorbents and its influence on selection of regeneration strategies. *Microporous Mesoporous Mater* 2008;116:506–12.
 - [16] Son WJ, Choi JK, Ahn WS. Adsorptive removal of carbon dioxide using polyethyleneimine-loaded mesoporous silica materials. *Microporous Mesoporous Mater* 2008;113:31–40.
 - [17] Gray ML, Hoffman JS, Hreha DC, et al. Parametric study of solid amine sorbents for the capture of carbon dioxide. *Energy Fuels* 2009;23:4840–4.
 - [18] Ma X, Wang X, Song C. Molecular basket sorbents for separation of CO₂ and H₂S from various gas streams. *J Am Chem Soc* 2009;131:5777–83.
 - [19] Ebner AD, Gray ML, Chisholm NG, et al. Suitability of a solid amine sorbent for CO₂ capture by pressure swing adsorption. *Ind Eng Chem Res* 2011;50:5634–41.
 - [20] Zhang W, Liu H, Sun C, Drage TC, Snape CE. Capturing CO₂ from ambient air using a polyethyleneimine-silica adsorbent in fluidized beds. *Chem Eng Sci* 2014;116:306–16.
 - [21] Zhang W, Liu H, Sun C, Drage TC, Snape CE. Performance of polyethyleneimine-silica adsorbent for post-combustion CO₂ capture in a bubbling fluidized bed. *Chem Eng J* 2014;251:293–303.
 - [22] Sjöstrom S, Krutka H, Starns T, Campbell T. Pilot test results of post-combustion CO₂ capture using solid sorbents. *Energy Proc* 2011;4:1584–92.
 - [23] Krutka H, Sjöstrom S, Starns T, Dillon M, Silverman R. Post-combustion CO₂ capture using solid sorbents: 1MWe pilot evaluation. *Energy Proc* 2013;37:73–88.
 - [24] Veneman R, Li ZS, Hogendoorn JA, Kersten SRA, Brilman DWF. Continuous CO₂ capture in a circulating fluidized bed using supported amine sorbents. *Chem Eng J* 2012;207–208:18–26.
 - [25] Spenik JL, Shadle LJ, Breault RW, Hoffman JS, Gray ML. Cyclic tests in batch mode of CO₂ adsorption and regeneration with sorbent consisting of immobilized amine on a mesoporous silica. *Ind Eng Chem Res* 2015;54:5388–97.
 - [26] Sjöstrom S, Krutka H. Evaluation of solid sorbents as a retrofit technology for CO₂ capture. *Fuel* 2010;89:1298–306.
 - [27] Heesink ABM, Veneman R, Magneschi G, Brilman DWF. Cutting the cost of carbon capture. *Power Engineering International*; 2013. <<http://www.powerengineeringint.com/articles/print/volume-21/issue-8/power-gen-europe-best-paper-award-winners/cutting-the-cost-of-carbon-capture.html>> [05/09/2013].
 - [28] Quang DV, Dindi A, Rayer AV, Hadri NE, Abdulkadir A, Abu-Zahra MRM. Effect of moisture on the heat capacity and the regeneration heat required for CO₂ capture process using PEI impregnated mesoporous precipitated silica. *Greenhouse Gas Sci Technol* 2014;1:1–11.
 - [29] Li K, Jiang J, Yan F, Tian S, Chen X. The influence of polyethyleneimine type and molecular weight on the CO₂ capture performance of PEI-nano silica adsorbents. *Appl Energy* 2014;136:750–5.
 - [30] Knowles GP, Graham JV, Delaney SW, Chaffee AL. Aminopropyl-functionalized mesoporous silicas as CO₂ adsorbents. *Fuel Process Technol* 2005;86:1435–48.
 - [31] Belmabkhout Y, Sayari A. Effect of pore expansion and amine functionalization of mesoporous silica on CO₂ adsorption over a wide range of conditions. *Adsorption* 2009;15:318–28.
 - [32] Pirngruber GD, Guillou F, Gomez A, Clausse M. A theoretical analysis of the energy consumption of post-combustion CO₂ capture processes by temperature swing adsorption using solid sorbents. *Int J Greenhouse Gas Control* 2013;14:74–83.
 - [33] Veneman R, Kamphuis H, Brilman DWF. Post-combustion CO₂ capture using supported amine sorbents: a process integration study. *Energy Proc* 2013;00:2100–8.
 - [34] Hedin N, Anderson L, Bergstrom L, Yan J. Adsorbents for the post-combustion capture of CO₂ using rapid temperature swing or vacuum swing adsorption. *Appl Energy* 2013;104:418–33.
 - [35] Maiti A, Bourcier WL, Aines RD. Atomistic modelling of CO₂ capture in primary and tertiary amines – heat of absorption and density changes. *Chem Phys Lett* 2011;509:25–8.
 - [36] Kim I, Svendsen HF. Heat of absorption of carbon dioxide (CO₂) in monoethanolamine (MEA) and 2-(aminoethyl)ethanolamine (AEEA) solutions. *Ind Eng Chem Res* 2007;46:5803–9.
 - [37] Sun Z, Fan M, Argyle M. Desorption kinetics of the monoethanolamine/macroporous TiO₂-based CO₂ separation process. *Energy Fuels* 2011;25:2988–96.
 - [38] Sun Z, Fan M, Argyle M. Supported monoethanolamine for CO₂ separation. *Ind Eng Chem Res* 2011;50:11343–9.
 - [39] McDonald TM, Lee WR, Mason JA, Wiers BM, Hong CS, Long JR. Capture of carbon dioxide from air and flue gas in the alkylamine-appended metal-organic framework mmen-Mg2(dobpdc). *J Am Chem Soc* 2012;134:7056–65.
 - [40] Mebane DS, Bhat KS, Kress JD, Fauth DJ, Gray ML, Lee A, et al. Bayesian calibration of thermodynamic models for the uptake of CO₂ in supported amine sorbents using ab initio priors. *Phys Chem Chem Phys* 2013;15:4355.
 - [41] Langmuir I. The constitution and fundamental properties of solids and liquids. Part I. Solids. *J Am Chem Soc* 1916;38:2221–95.
 - [42] Fauth DJ, Gray ML, Pennline HW. Investigation of porous silica supported mixed-amine sorbents for post-combustion CO₂ capture. *Energy Fuels* 2012;26:2483–96.
 - [43] Xu X, Song C, Andresen JM, Miller BG, Scaroni AW. Novel polyethyleneimine-modified mesoporous molecular sieve of MCM-41 type as high-capacity adsorbent for CO₂ capture. *Energy Fuels* 2002;16:1463–9.
 - [44] Yue MB, Chun Y, Cao Y, Dong X, Zhu JH. Novel CO₂-capturer derived from the as-prepared SBA-15 occluded by template. *Adv Funct Mater* 2006;16:1717–22.
 - [45] Yokoyama T. Analysis of reboiler heat duty in MEA process for CO₂ capture using equilibrium-staged model. *Sep Purif Technol* 2012;94:97–103.
 - [46] Yang WC, Hoffman J. Exploratory design study on reactor configurations for carbon dioxide capture from conventional power plants employing regenerable solid sorbents. *Ind Eng Chem Res* 2009;48:341–51.
 - [47] Quang DV, Rabindran AV, Hadri NE, Abu-Zahra MRM. Reduction in the regeneration energy of CO₂ capture process by impregnating amine solvent onto precipitated silica. *Eur Sci J* 2013;9(30):82–102.
 - [48] Chiu LF, Liu HF, Li MH. Heat capacity of alkanolamines by differential scanning calorimetry. *J Chem Eng Data* 1999;44:631–6.
 - [49] Shih TW, Chen YJ, Li MH. Heat capacity of aqueous mixtures of monoethanolamine with 2-piperidineethanol. *Thermochim Acta* 2002;389:33–41.
 - [50] Hoffman JS, Hammache S, Gray ML, Fauth DJ, Pennline HW. Parametric study for an immobilized amine sorbent in a regenerative carbon dioxide capture process. *Fuel Process Technol* 2014;126:173–87.
 - [51] Li W, Choi S, Drese JH, Hornbostel M, Krishnan G, Eisenberger PM, et al. Steam-stripping for regeneration of supported amine-based CO₂ adsorbents. *ChemSusChem* 2010;3:899–903.
 - [52] Li W, Bollini P, Didas SA, Choi S, Drese JH, Jones GW. Structural changes of silica mesocellular foam supported amine-functionalized CO₂ adsorbents upon exposure to steam. *ACS Appl Mater Interfaces* 2010;2:3363–72.
 - [53] Hammache S, Hoffman JS, Gray ML, Fauth DJ, Howard BH, Pennline HW. Comprehensive study of the impact of steam on polyethyleneimine on silica for CO₂ capture. *Energy Fuels* 2013;27:6899–905.
 - [54] Veneman R, Fridka N, Zhao W, Li Z, Kersten S. Adsorption of H₂O and CO₂ on supported amine sorbents. *Int J Greenhouse Gas Control* 2015;41:268–75.
 - [55] Stover B, Bergins C, Klebes J. Optimized post combustion carbon capturing on coal fired power plants. *Energy Proc* 2011;4:1637–43.
 - [56] Amrollahi Z, Ystad PAM, Ertesvay IS, Bolland O. Optimized process configurations of post-combustion CO₂ capture for natural-gas-fired power plant – power plant efficiency analysis. *Int J Greenhouse Gas Control* 2012;8:1–11.
 - [57] Park YK, Seo H, Kang NY, Choi WC. Apparatus for capturing of carbon dioxide. *PCT/KR2013/00583*; 2013.
 - [58] Kim K, Son Y, Lee WB, Lee KS. Moving bed adsorption process with internal heat integration for carbon dioxide capture. *Int J Greenhouse Gas Control* 2013;17:13–24.
 - [59] Kim K, Park Y-K, Park J, Jung E, Seo H, Kim H, et al. Performance comparison of moving and fluidized bed sorption systems for an energy-efficient solid sorbent-based carbon capture process. *Energy Proc* 2014;63:1151–61.
 - [60] Kim K, Kim D, Park YK, Lee KS. A solid sorbent-based multi-stage fluidized bed process with inter-stage heat integration as an energy efficient carbon capture process. *Int J Greenhouse Gas Control* 2014;26:135–46.
 - [61] Veneman R, Hilbers T, Brilman DWF, Kersten SRA. CO₂ capture in a continuous gas-solid trickle flow reactor. *Chem Eng J* 2016. <http://dx.doi.org/10.1016/j.cej.2015.12.066>.
 - [62] Schony G, Zehetner E, Fuchs J, Proll T, Sprachmann G, Hofbauer H. Design of a bench scale unit for continuous CO₂ capture via temperature swing adsorption – fluid-dynamic feasibility study. *Chem Eng Res Des* 2015. <http://dx.doi.org/10.1016/j.cherd.2015.12.018>.
 - [63] Proll T, Schony G, Sprachmann G, Hofbauer H. Introduction and evaluation of a double loop staged fluidized bed system for post-combustion CO₂ capture using solid sorbents in a continuous temperature swing adsorption process. *Chem Eng Sci* 2016;141:166–74.